



Underground Storage Training and Consulting, LLC (ustandc.com)

John E. Kneece





ATG Test Reports & Alarm History Reports





ATG Test Reports & Alarm History Reports

EPA's Automatic Tank Gauging Systems for
Release Detection: Reference Manual for
Underground Storage Tank Inspectors

Else;

Reference the national work group's site
at www.nwglde.org for phone numbers
for tank gauge manufacturers.

Else;

Call Tim Smith *Else;*



ATG Test Reports & Alarm History Reports





ATG Test Reports & Alarm History Reports

Test Reports

- Tank Test Results
- Line Test Results



JUL 24, 2012 2:43 PM

CSLD TEST RESULTS

JUL 24, 2012 2:43 PM

T 1:PREMIUM
PROBE SERIAL NUM 824980

0.2 GAL/HR TEST
PER: JUL 24, 2012 PASS

* * * * * END * * * * *

T 2:REGULAR
PROBE SERIAL NUM 824979

0.2 GAL/HR TEST
PER: JUL 24, 2012 PASS

* * * * * END * * * * *

T 3:DIESEL
PROBE SERIAL NUM 804162

0.2 GAL/HR TEST
PER: JUL 24, 2012 PASS

* * * * * END * * * * *

T 4:E85
PROBE SERIAL NUM 602515

0.2 GAL/HR TEST
PER: JUL 24, 2012 PASS

* * * * * END * * * * *

JUL 24, 2012 2:43 PM

PRESSURE LINE LEAK TEST
RESULTS

Q 1:PREMIUM

3.0 GAL/HR RESULTS:

LAST TEST:
JUL 24, 2012 2:43PM PASS

NUMBER OF TESTS PASSED
PREV 24 HOURS : 29
SINCE MIDNIGHT : 12

0.20 GAL/HR RESULTS:

JUL 22, 2012 10:17PM PASS
JUL 20, 2012 7:21AM PASS
JUL 16, 2012 1:27PM PASS
JUL 12, 2012 9:11PM PASS
JUL 10, 2012 7:00AM PASS
JUL 6, 2012 8:58AM PASS
JUL 2, 2012 9:05AM PASS
JUN 28, 2012 9:38PM PASS
JUN 26, 2012 7:25AM PASS
JUN 22, 2012 7:30AM PASS

0.10 GAL/HR RESULTS:

MAR 12, 2012 3:40PM PASS
SEP 30, 2011 7:17AM PASS
MAR 30, 2011 7:34AM PASS

JUL 24, 2012 2:44 PM

PRESSURE LINE LEAK TEST
RESULTS

Q 2:REGULAR

3.0 GAL/HR RESULTS:

LAST TEST:
JUL 24, 2012 2:42PM PASS

NUMBER OF TESTS PASSED
PREV 24 HOURS : 185
SINCE MIDNIGHT : 96

0.20 GAL/HR RESULTS:

JUL 20, 2012 11:49PM PASS
JUL 15, 2012 12:25AM PASS
JUL 10, 2012 11:34PM PASS
JUL 8, 2012 6:52AM PASS
JUL 2, 2012 11:25PM PASS
JUN 26, 2012 11:26PM PASS
JUN 20, 2012 11:34PM PASS
JUN 14, 2012 11:15PM PASS
JUN 8, 2012 11:58PM PASS
JUN 3, 2012 12:18AM PASS

0.10 GAL/HR RESULTS:

MAR 15, 2012 12:30AM PASS
OCT 2, 2011 1:03AM PASS
MAR 30, 2011 11:29PM PASS

JUL 24, 2012 2:44 PM

PRESSURE LINE LEAK TEST
RESULTS

Q 3:DIESEL

3.0 GAL/HR RESULTS:

LAST TEST:
MAR 12, 2012 2:17PM PASS

NUMBER OF TESTS PASSED
PREV 24 HOURS : 0
SINCE MIDNIGHT : 0

0.20 GAL/HR RESULTS:

JUN 20, 2011 1:25PM PASS
JUN 16, 2011 1:33PM PASS
JUN 12, 2011 10:34AM PASS
JUN 8, 2011 1:19PM PASS
JUN 4, 2011 12:19PM PASS
MAY 31, 2011 1:39PM PASS
MAY 27, 2011 12:15PM PASS
MAY 23, 2011 10:03AM PASS
MAY 19, 2011 9:04AM PASS
MAY 15, 2011 2:15PM PASS

0.10 GAL/HR RESULTS:

MAR 29, 2011 8:54PM PASS

JUL 24, 2012 2:44 PM

PRESSURE LINE LEAK TEST
RESULTS

Q 4:E-85

3.0 GAL/HR RESULTS:

LAST TEST:

JUL 24, 2012 1:12PM PASS

NUMBER OF TESTS PASSED

PREV 24 HOURS : 3
SINCE MIDNIGHT : 2

0.20 GAL/HR RESULTS:

JUL 24, 2012 1:58PM PASS
JUL 20, 2012 12:48PM PASS
JUL 16, 2012 7:00PM PASS
JUL 12, 2012 4:18PM PASS
JUL 8, 2012 2:18PM PASS
JUL 2, 2012 3:23PM PASS
JUN 26, 2012 5:46PM PASS
JUN 22, 2012 1:45PM PASS
JUN 16, 2012 2:32PM PASS
JUN 12, 2012 3:51PM PASS

0.10 GAL/HR RESULTS:

MAR 12, 2012 3:06PM PASS
SEP 30, 2011 7:49AM PASS
MAR 29, 2011 9:28PM PASS

APR 7, 2010 1:33 PM

WPLLD LINE LEAK
TEST RESULTS

W 1: SUPREME

3.0 GAL/HR RESULTS:

LAST TEST:

JAN 15, 2010 12:35PM PASS

NUMBER OF TESTS PASSED

PREV 24 HOURS : 0
SINCE MIDNIGHT : 0

0.20 GAL/HR RESULTS:

MAY 1, 2009 2:04PM PASS
JAN 3, 2009 3:05PM PASS
JAN 1, 2009 11:55PM PASS
MAR 14, 2008 5:36PM PASS
JAN 4, 2008 11:27PM PASS
JAN 3, 2008 11:04PM PASS
NOV 7, 2007 6:26PM PASS
NOV 7, 2007 3:52PM PASS
NOV 6, 2007 10:42AM PASS
NOV 4, 2007 6:08PM PASS

0.10 GAL/HR RESULTS:

MAY 1, 2009 2:50PM PASS
JAN 3, 2009 8:48PM PASS
MAR 14, 2008 5:52PM PASS
JAN 4, 2008 11:58PM PASS
NOV 7, 2007 6:57PM PASS
NOV 4, 2007 7:41PM PASS
JUL 5, 2007 5:41PM PASS
JUN 26, 2007 6:14PM PASS
APR 19, 2007 11:39PM PASS
JAN 1, 2007 5:24PM PASS



ATG Test Reports & Alarm History Reports

Test History

- Tank Tests
- Line Tests



JUL 26, 2012 12:28 PM

TANK LEAK TEST HISTORY

T 4:OFFROAD

LAST GROSS TEST PASSED:

NO TEST PASSED

LAST ANNUAL TEST PASSED:

NO TEST PASSED

FULLEST ANNUAL TEST PASS

NO TEST PASSED

LAST PERIODIC TEST PASS:

JUL 26, 2012 9:55 AM
TEST LENGTH 58 HOURS
STARTING VOLUME= 1280
PERCENT VOLUME = 63.9
TEST TYPE = CSLD

FULLEST PERIODIC TEST
PASSED EACH MONTH:

JAN 21, 2012 4:38 AM
TEST LENGTH 48 HOURS
STARTING VOLUME= 1678
PERCENT VOLUME = 83.8
TEST TYPE = CSLD

FEB 7, 2012 4:01 PM
TEST LENGTH 33 HOURS
STARTING VOLUME= 1371
PERCENT VOLUME = 68.4
TEST TYPE = CSLD

MAR 18, 2012 3:41 PM
TEST LENGTH 44 HOURS
STARTING VOLUME= 1442
PERCENT VOLUME = 72.0
TEST TYPE = CSLD

APR 8, 2012 11:39 AM
TEST LENGTH 43 HOURS
STARTING VOLUME= 1540
PERCENT VOLUME = 76.9
TEST TYPE = CSLD

MAY 16, 2012 1:27 PM
TEST LENGTH 61 HOURS
STARTING VOLUME= 1477
PERCENT VOLUME = 73.7
TEST TYPE = CSLD

JUN 27, 2012 11:41 PM
TEST LENGTH 44 HOURS
STARTING VOLUME= 1411
PERCENT VOLUME = 70.4
TEST TYPE = CSLD

JUL 22, 2012 1:59 AM
TEST LENGTH 58 HOURS
STARTING VOLUME= 1681
PERCENT VOLUME = 83.9
TEST TYPE = CSLD

AUG 17, 2011 8:24 PM
TEST LENGTH 62 HOURS
STARTING VOLUME= 1514
PERCENT VOLUME = 75.6
TEST TYPE = CSLD

SEP 29, 2011 11:52 AM
TEST LENGTH 64 HOURS
STARTING VOLUME= 1754
PERCENT VOLUME = 87.6
TEST TYPE = CSLD

OCT 1, 2011 1:14 AM
TEST LENGTH 56 HOURS
STARTING VOLUME= 1741
PERCENT VOLUME = 86.9
TEST TYPE = CSLD

NOV 14, 2011 3:00 AM
TEST LENGTH 64 HOURS
STARTING VOLUME= 1627
PERCENT VOLUME = 81.2
TEST TYPE = CSLD

DEC 27, 2011 4:24 PM
TEST LENGTH 43 HOURS
STARTING VOLUME= 1427
PERCENT VOLUME = 71.2
TEST TYPE = CSLD

***** END *****

TANK LEAK TEST HISTORY

T 2:DIESEL

LAST GROSS TEST PASSED:
JUL 26, 2012 11:34 AM
STARTING VOLUME= 2618
PERCENT VOLUME = 43.3
TEST TYPE = STANDARD

LAST ANNUAL TEST PASSED:

NO TEST PASSED

FULLEST ANNUAL TEST PASS

NO TEST PASSED

LAST PERIODIC TEST PASS:
JUL 26, 2012 11:16 AM
TEST LENGTH 35 HOURS
STARTING VOLUME= 3447
PERCENT VOLUME = 57.0
TEST TYPE = CSLD

FULLEST PERIODIC TEST
PASSED EACH MONTH:

JAN 11, 2012 11:29 AM
TEST LENGTH 39 HOURS
STARTING VOLUME= 2758
PERCENT VOLUME = 45.6
TEST TYPE = CSLD

FEB 22, 2012 7:27 AM
TEST LENGTH 41 HOURS
STARTING VOLUME= 2494
PERCENT VOLUME = 41.3
TEST TYPE = CSLD

MAR 24, 2012 7:40 AM
TEST LENGTH 38 HOURS
STARTING VOLUME= 4529
PERCENT VOLUME = 74.9
TEST TYPE = CSLD

APR 14, 2012 6:01 PM
TEST LENGTH 36 HOURS
STARTING VOLUME= 3625
PERCENT VOLUME = 60.0
TEST TYPE = CSLD

MAY 12, 2012 7:03 AM
TEST LENGTH 32 HOURS
STARTING VOLUME= 3569
PERCENT VOLUME = 59.0
TEST TYPE = CSLD

JUN 14, 2012 10:14 PM
TEST LENGTH 42 HOURS
STARTING VOLUME= 2824
PERCENT VOLUME = 46.7
TEST TYPE = CSLD

JUL 12, 2012 5:03 AM
TEST LENGTH 49 HOURS
STARTING VOLUME= 3761
PERCENT VOLUME = 62.2
TEST TYPE = CSLD

AUG 25, 2011 10:29 PM
TEST LENGTH 45 HOURS
STARTING VOLUME= 3537
PERCENT VOLUME = 58.5
TEST TYPE = CSLD

SEP 1, 2011 12:01 AM
TEST LENGTH 46 HOURS
STARTING VOLUME= 3167
PERCENT VOLUME = 52.4
TEST TYPE = CSLD

OCT 16, 2011 8:22 PM
TEST LENGTH 33 HOURS
STARTING VOLUME= 2926
PERCENT VOLUME = 48.4
TEST TYPE = CSLD

NOV 18, 2011 8:07 AM
TEST LENGTH 45 HOURS
STARTING VOLUME= 2054
PERCENT VOLUME = 34.0
TEST TYPE = CSLD

DEC 30, 2011 11:04 PM
TEST LENGTH 46 HOURS
STARTING VOLUME= 2045
PERCENT VOLUME = 33.8
TEST TYPE = CSLD


***** END *****



ATG Test Reports & Alarm History Reports

Alarm History Reports

- System Alarm History
- Tank Alarm History
- Sensor Alarm History

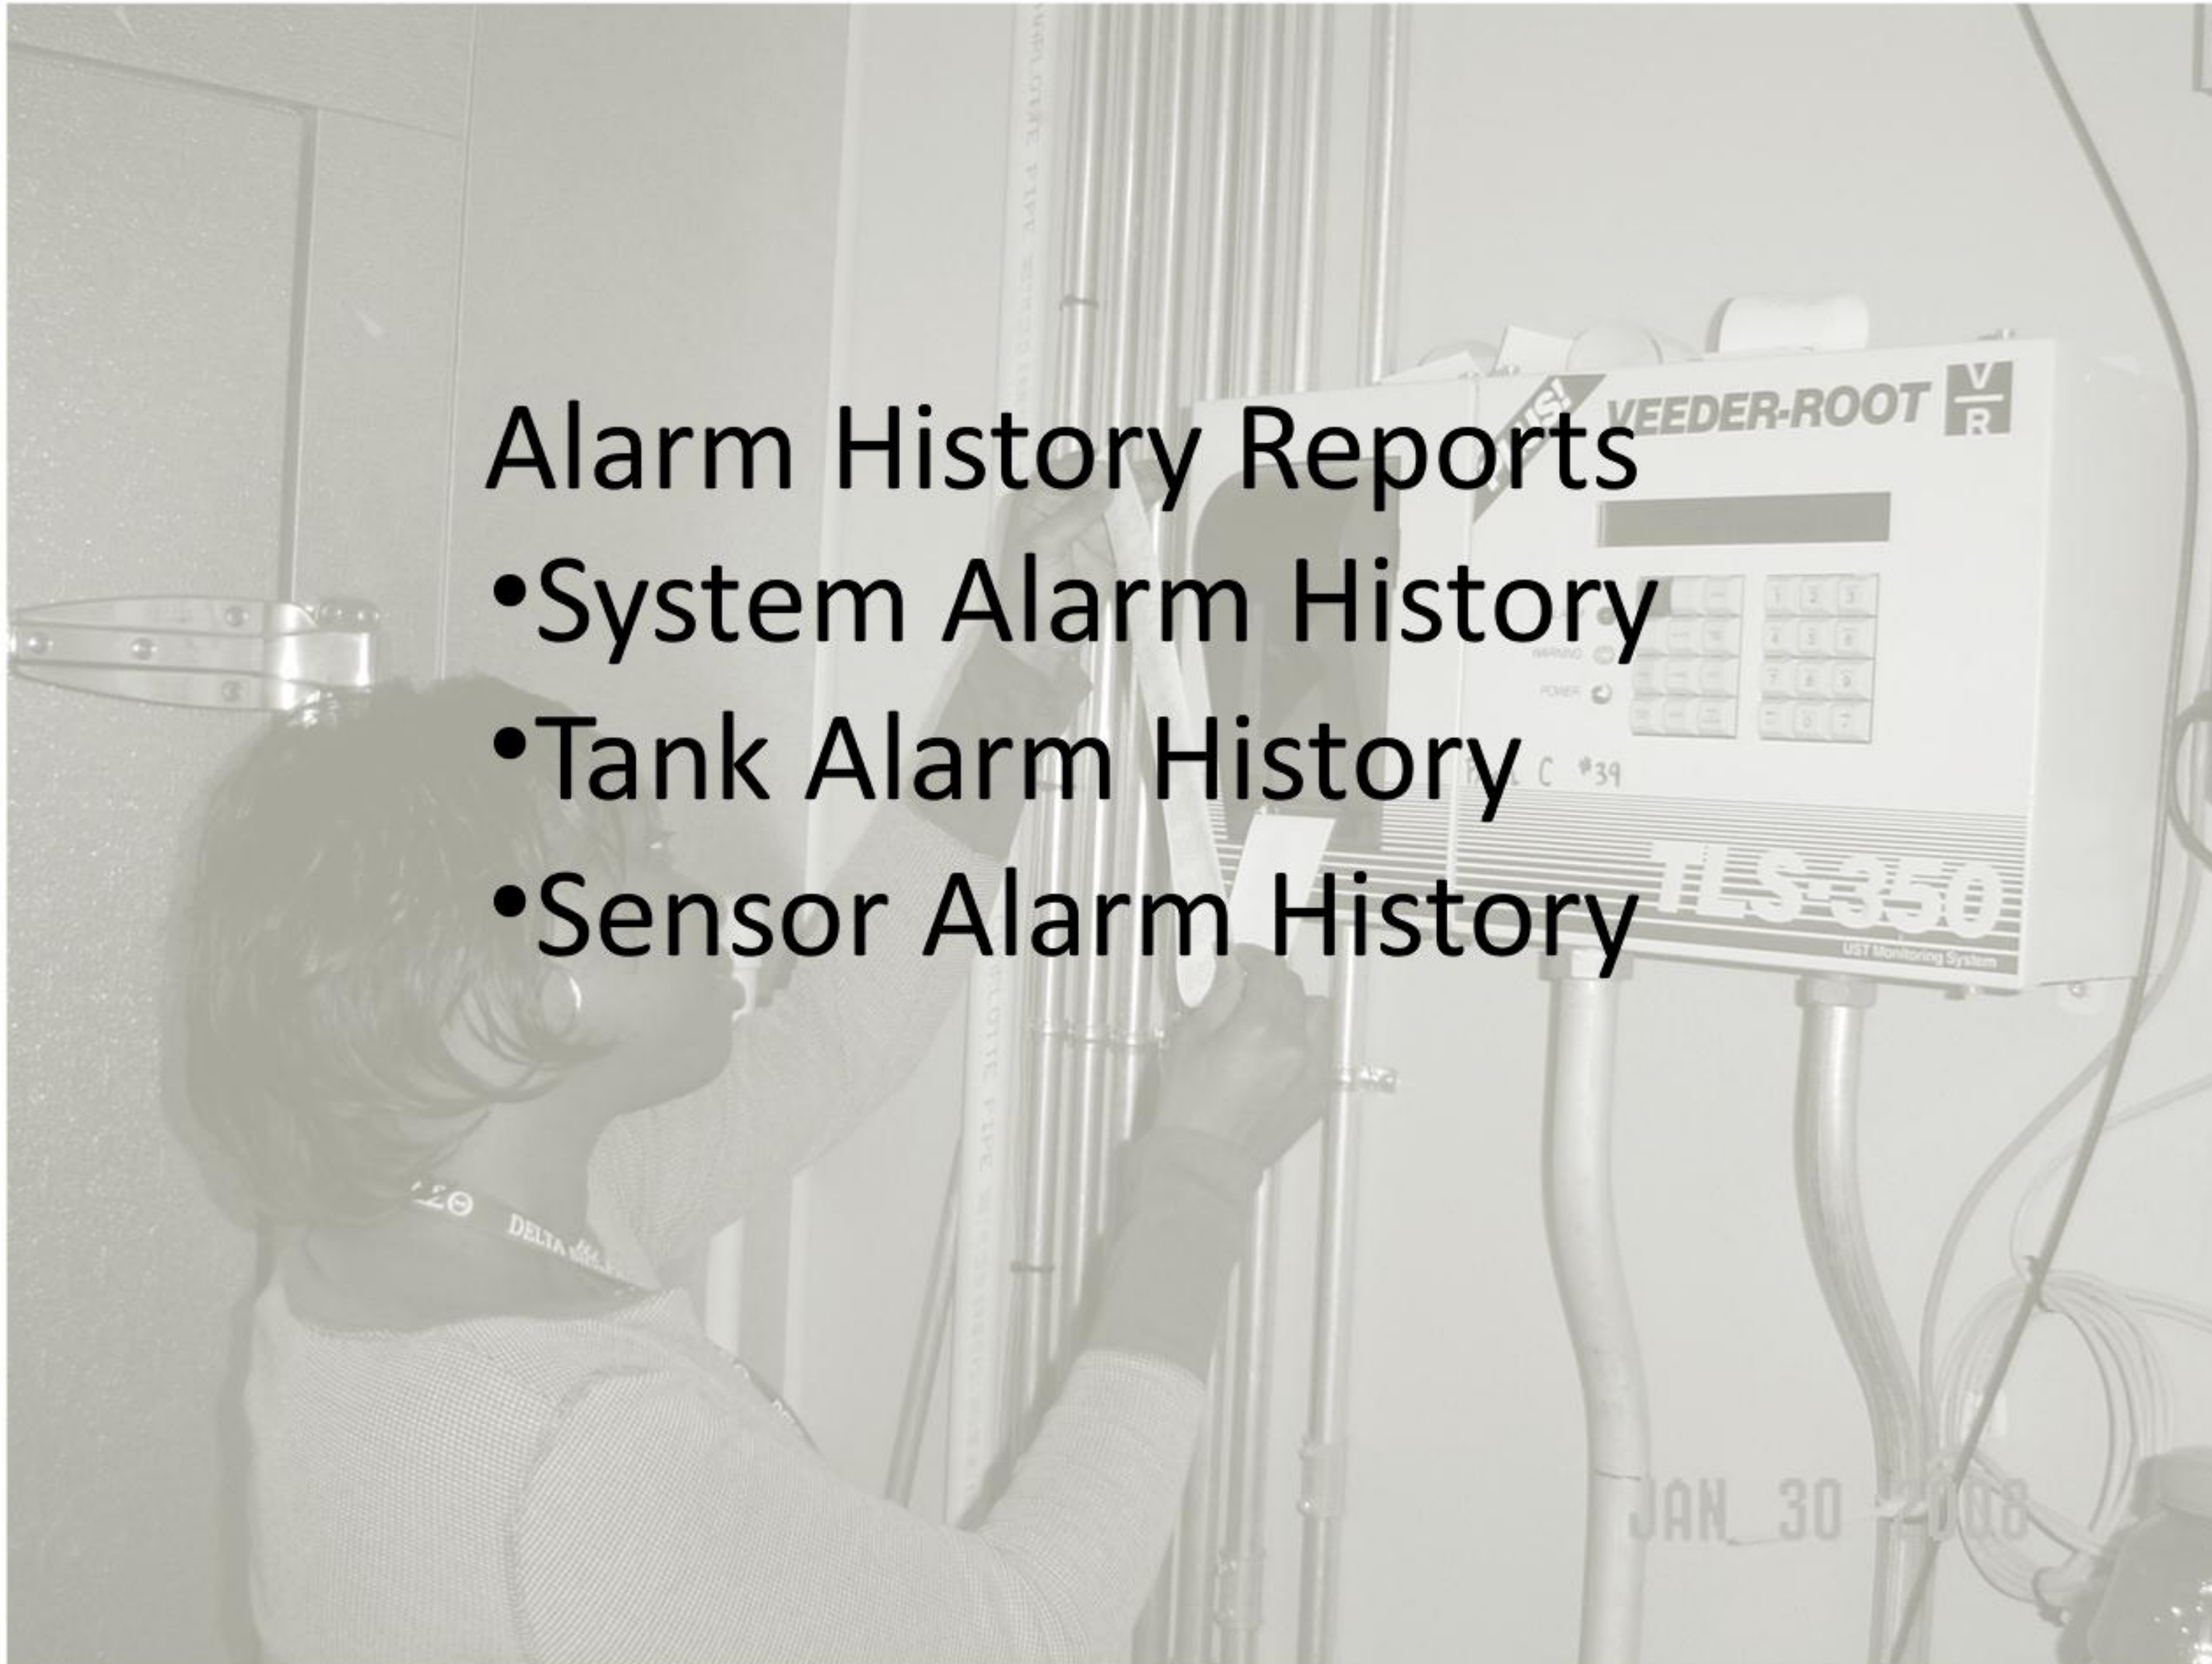

ALARM HISTORY REPORT

----- IN-TANK ALARM -----

T 2:REGULAR

OVERFILL ALARM

JUL 19, 2012 5:35 PM
JUL 11, 2012 4:58 PM
JUL 7, 2012 7:22 AM

LOW PRODUCT ALARM

APR 9, 2012 1:40 PM
FEB 10, 2012 1:52 PM
JAN 29, 2012 4:36 PM

HIGH PRODUCT ALARM

JUN 9, 2012 6:17 AM
FEB 2, 2012 8:04 PM
DEC 21, 2011 8:51 AM

INVALID FUEL LEVEL

FEB 10, 2012 5:45 PM
JUL 1, 2011 6:47 PM
APR 13, 2011 12:06 PM

DELIVERY NEEDED

JUN 14, 2012 4:41 PM
APR 9, 2012 1:32 PM
FEB 17, 2012 12:28 PM

T 3:DIESEL

OVERFILL ALARM

MAY 18, 2012 9:18 AM
APR 23, 2012 6:09 PM
MAR 25, 2012 12:25 AM

LOW PRODUCT ALARM

MAR 21, 2012 11:35 AM
FEB 2, 2012 7:55 AM
JAN 8, 2012 2:29 PM

HIGH PRODUCT ALARM

MAR 25, 2012 12:26 AM
JAN 12, 2012 3:27 PM

INVALID FUEL LEVEL

NOV 23, 2011 10:45 AM
MAY 7, 2011 8:16 PM

DELIVERY NEEDED

NOV 23, 2011 10:45 AM
JUL 1, 2011 4:40 PM
MAY 21, 2011 4:28 PM

ALARM HISTORY REPORT

----- SYSTEM ALARM -----

PAPER OUT
JUL 15, 2012 1:06 PM
PRINTER ERROR
JUL 15, 2012 1:06 PM
BATTERY IS OFF
NOV 10, 2003 8:00 AM
SYS SECURITY WARNING
OCT 17, 2011 1:01 PM

ALARM HISTORY REPORT

----- IN-TANK ALARM -----

T 1:PREMIUM

LOW PRODUCT ALARM

JAN 6, 2012 5:30 PM
NOV 25, 2011 1:48 PM
NOV 23, 2011 10:39 AM

INVALID FUEL LEVEL

NOV 23, 2011 10:39 AM

DELIVERY NEEDED

JAN 26, 2012 5:48 PM
JAN 8, 2012 2:14 PM
JAN 4, 2012 1:46 PM

ALARM HISTORY REPORT

----- IN-TANK ALARM -----

T 4:E85

OVERFILL ALARM

MAY 14, 2011 12:56 AM

LOW PRODUCT ALARM

JUL 13, 2011 2:41 PM
MAY 3, 2011 10:49 PM

HIGH PRODUCT ALARM

JUL 14, 2011 2:00 PM

INVALID FUEL LEVEL

JUL 13, 2011 2:41 PM

PROBE OUT

JUL 14, 2011 2:13 PM
JUL 14, 2011 2:06 PM
JUL 14, 2011 1:52 PM

DELIVERY NEEDED

JUL 13, 2011 2:41 PM
MAY 6, 2011 2:21 AM

MAX PRODUCT ALARM

JUL 14, 2011 2:00 PM

ALARM HISTORY REPORT

----- SENSOR ALARM -----

G 1:PREMIUM

PLLD SHUTDOWN ALARM

JUN 21, 2011 3:12 PM

GROSS LINE FAIL

JUN 21, 2011 3:12 PM

PLLD SHUTDOWN ALARM

JUN 21, 2011 2:08 PM

GROSS LINE FAIL

JUN 21, 2011 2:08 PM

PLLD SHUTDOWN ALARM

JUN 21, 2011 1:57 PM

GROSS LINE FAIL

JUN 21, 2011 1:57 PM

PLLD SHUTDOWN ALARM

JUN 21, 2011 1:38 PM

GROSS LINE FAIL

JUN 21, 2011 1:38 PM

***** END *****



ATG Test Reports & Alarm History Reports

Questions?

- * Give me a shout at www.ustandc.com
- * Call 803-429-5271

